

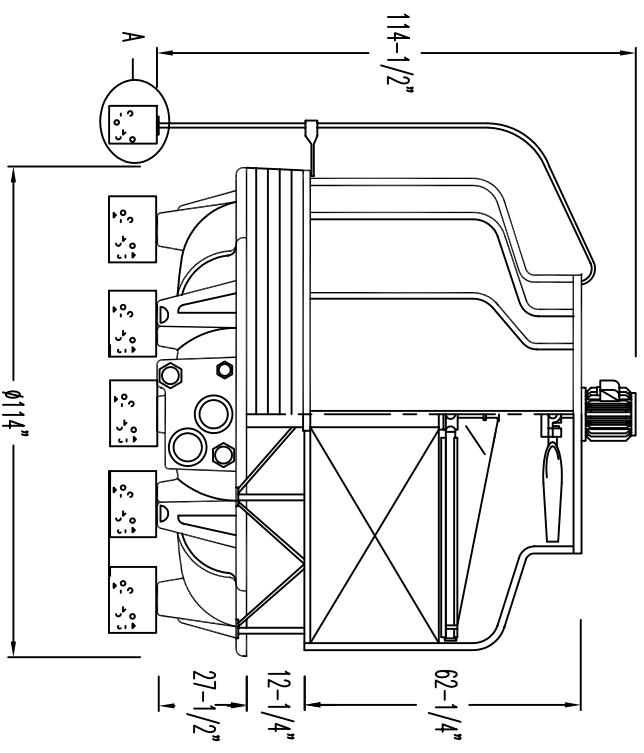


TOWER FOUNDATION



TOWER OVERALL DIMENSION

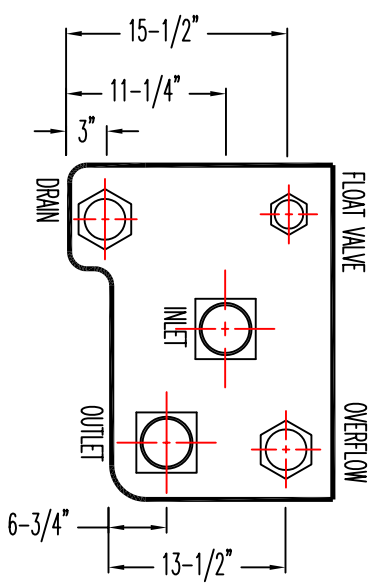

DETAIL A

LOADING POINT(lbs)	TOWER WEIGHT(lbs)	
	NET WEIGHT	OPERATING WEIGHT
STAND	965	1100
TANK	—	2895
OUTLET	5"	5"
INLET	5"	5"
OVERFLOW	2"	2"
DRAIN	2"	2"
AUTOMATIC MAKE-UP	3/4"	3/4"
MANUAL MAKE-UP	—	—

APPROVED	KM LIN	06/27/2007	DWG TITLE:	TOWER DIMENSIONS AND FOUNDATION
CHECKED	NOJUN	11/06/2007	DWG DETAIL:	PCT-100
DRAWN	HUANG	06/27/2007	DWG NO.:	AFP-0100-0
ITEM	ZENG	06/26/2007	DATE	DO NOT SCALE

PROTEC COOLING TOWERS, INC.

- NOTES:
1. THE COOLING TOWER MUST BE LOCATED AT SUCH DISTANCE AND DIRECTION TO AVOID THE POSSIBILITY OF CONTAMINATED TOWER DISCHARGE AIR BEING DRAWN INTO BUILDING FRESH AIR INTAKES
 2. ANCHOR BOLT BY OTHERS.
 3. CONTINUING ENGINEERING RESEARCH RESULTS IN STEADY IMPROVEMENTS. THEREFORE, THESE SPECIFICATIONS AND DATA ARE SUBJECT TO CHANGE WITHOUT NOTICE. CONSULT WITH FACTORY FOR CURRENT CERTIFIED DIMENSIONS.